



CERTIFICATE OF QUALITY

EverSure™ Type GP Cement

NZS3122:2009 (Bulk Despatch)



Our
NZ made
cement is
genuine
NZ grade
cement.

Issued to: National Sales Manager

Test Report No:

20#233

info@goldenbay.co.nz

Code	Week Ending / Voyage	Specific Surface Area	Normal Consistency	Initial Set	Final Set	Soundness	Compressive Strength						Free Lime	Sodium Equivalent (NaEq)	Sulphur Trioxide (SO3)	
							ISOCEN			Concrete						
							3 days	7 days	28 days	Slump	3 days	7 days				28 days
Mean		343	29.0	130	3:31	1	31.7	44.9	65.1	90.4	25.5	34.1	45.6	1.9	0.55	2.2
Standard Deviation		9	0.3	11	0:09	0.4	1.4	1.7	1.2	5.2	2.6	2.6	2.0	0.2	0.01	0.04
Min		320	28.4	120	3:15	1	28.6	41.0	63.5	85.0	21.0	30.2	42.4	1.5	0.54	2.1
Max		355	29.4	150	3:45	2	33.9	47.4	67.3	100.0	28.9	37.6	47.8	2.4	0.56	2.3
NZS 3122:2009 Requirements				45 min	6:00 max	5 max		35.0 min	45.0 min						0.6 max	3.5 max
Units		m2/kg	%	minutes	hrs:mins	mm	MPa	MPa	MPa	mm	MPa	MPa	MPa	%	%	%
201209-470-GP	09/12/20	325	29.4	120	3:30	1	33.9							2.1	0.56	2.2
201207-468-GP	07/12/20	330	29.2	120	3:45	1	32.3			90.0	28.3			1.9	0.56	2.2
201205-134-GP	05/12/20	350	29.4	120	3:30	1	32.8	46.7		85	27.6	35.5		1.9	0.56	2.1
201203-136-GP	03/12/20	340	29.2	120	3:30	1	32.0	47.4						1.7	0.56	2.2
201127-755-GP	27/11/20	320	29.2	135	3:45	1	32.2	45.7						1.5	0.54	2.1
201125-749-GP	25/11/20	340	29.1	120	3:30	2	31.8	45.5		90	27.6	37.4		1.7	0.56	2.2
201123-551-GP	23/11/20	345	29.1	135	3:30	1	31.8	44.3						1.8	0.54	2.2
201117-393-GP	17/11/20	355	29.1	120	3:30	1	33.9	45.4		90	28.9	37.6		1.9	0.56	2.2
201112-974-GP	12/11/20	350	29.1	135	3:15	2	32.1	45.9	65.2	85	27.5	37.0	47.7	1.8	0.55	2.2
201111-972-GP	11/11/20	345	29.4	135	3:30	1	32.0	45.6	66.8					1.9	0.55	2.2
201104-522-GP	04/11/20	340	28.9	120	3:30	1	32.2	46.6	65.9	85	26.6	34.3	46.9	1.8	0.56	2.2
201103-714-GP	03/11/20	335	29.0	120	3:30	2	32.2	45.3	66.3					1.8	0.56	2.2
201028-204-GP	28/10/20	335	29.0	135	3:45	2	32.0	46.6	66.5	85	26.9	35.2	47.8	1.9	0.55	2.2
201027-206-GP	27/10/20	345	29.0	135	3:30	2	32.3	45.6	63.9					1.8	0.56	2.2
201020-801-GP	20/10/20	350	28.9	135	3:30	1	32.6	44.3	64.5	90	24.3	32.3	46.0	2.0	0.55	2.2
201018-799-GP	18/10/20	350	28.8	120	3:30	2	32.3	46.2	66.5					2.1	0.55	2.2
201015-478-GP	15/10/20	340	28.8	120	3:30	2	32.7	46.8	67.3	90	24.5	33.6	44.2	2.4	0.55	2.2
201013-476-GP	13/10/20	350	28.8	120	3:30	2	31.5	44.9	65.5					2.1	0.55	2.2
201011-117-GP	11/10/20	345	28.5	135	3:15	2	31.7	44.9	63.5					1.7	0.55	2.2
201006-115-GP	06/10/20	345	28.4	120	3:15	1	31.2	44.3	64.8	100	23.5	33.2	43.6	1.9	0.56	2.2
201001-699-GP	01/10/20	350	28.7	150	3:45	1	29.2	43.2	63.9					2.2	0.56	2.2
200929-697-GP	29/09/20	355	28.5	150	3:15	2	29.3	42.4	63.6	95	21.8	30.2	42.4	2.1	0.56	2.3
200925-327-GP	25/09/20	345	28.8	150	3:45	2	28.9	42.0	63.6	90	23.2	32.1	47.3	2.1	0.56	2.3
200923-329-GP	23/09/20	340	28.8	135	3:45	1	31.4	42.2	64.6					2.3	0.56	2.2
200919-098-GP	19/09/20	340	28.9	135	3:45	1	28.6	41.0	65.0	100	21.0	30.3	44.3	2.2	0.55	2.2

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of:

Chemical composition to ASTM C114-18

- Concrete Compressive Strength test results outside the scope of accreditation

No result available at time of certificate issue

Sample retested

This Report must not be reproduced except in full

Technical Manager
Raki Harding

Date issued: 17/12/20



Portland Works, Portland, Whangarei 0178
Page 1 of 3




**EverSure™
Type GP Cement**



**Compressive Strength ISO-CEN Mortar
(Bulk Despatch)**

—x— 28 Days —■— 7 Days —◆— 3 Days

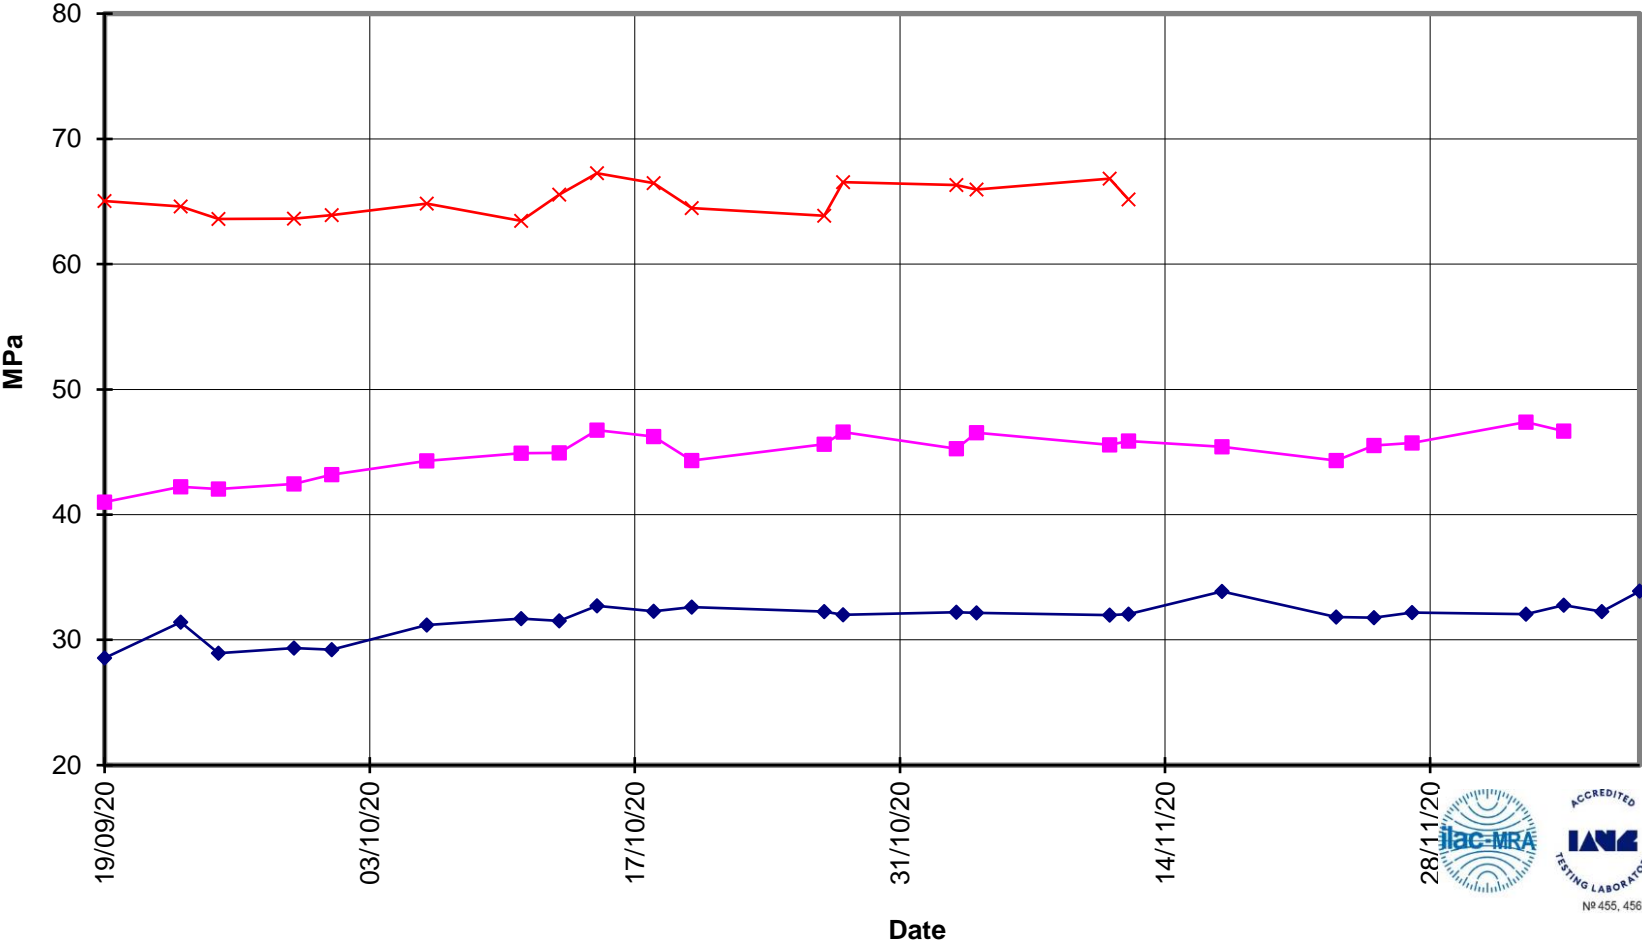



**EverSure™
Type GP Cement**



**Compressive Strength Concrete
(Bulk Despatch)**

—x— 28 Days —■— 7 Days —◆— 3 Days —■— Slump

