



CERTIFICATE OF QUALITY

EcoSure® Type GP Cement

NZS3122:2009 (Bulk Despatch)



Issued to: National Sales Manager

Test Report No: 23#10

info@goldenbay.co.nz

| Code | Week Ending / Voyage | Specific Surface Area | Normal Consistency | Initial Set | Final Set | Soundness | Compressive Strength | | | | | | Free Lime | Sodium Equivalent (NaEq) | Sulphur Trioxide (SO3) | |
|----------------------------|----------------------|-----------------------|--------------------|-------------|-----------|-----------|----------------------|----------|----------|----------|--------|--------|-----------|--------------------------|------------------------|---------|
| | | | | | | | ISOCEN | | | Concrete | | | | | | |
| | | | | | | | 3 days | 7 days | 28 days | Slump | 3 days | 7 days | | | | 28 days |
| Mean | | 344 | 29.0 | 140 | 3:40 | 1 | 30.8 | 43.7 | 65.1 | 95 | 22.8 | 33.7 | 48.8 | 2.0 | 0.54 | 2.2 |
| Standard Deviation | | 13 | 0.3 | 8 | 0:14 | 0 | 1.3 | 2.1 | 1.5 | 9 | 1.1 | 1.6 | 2.7 | 0.3 | 0.01 | 0.05 |
| Min | | 320 | 28.5 | 120 | 3:15 | 1 | 28.6 | 39.4 | 62.1 | 80 | 21.3 | 30.5 | 45.4 | 1.4 | 0.52 | 2.1 |
| Max | | 375 | 29.5 | 150 | 4:00 | 2 | 33.6 | 48.8 | 68.5 | 110 | 25.0 | 36.0 | 52.6 | 2.4 | 0.57 | 2.3 |
| NZS 3122:2009 Requirements | | | | 45 min | 6:00 max | 5 max | | 35.0 min | 45.0 min | | | | | | 0.6 max | 3.5 max |
| Units | | m2/kg | % | minutes | hrs:mins | mm | MPa | MPa | MPa | mm | MPa | MPa | MPa | % | % | % |
| 230113-325-GP | 13/01/23 | 345 | 29.1 | 150 | 3:45 | 1 | 31.6 | | | | | | | 1.9 | 0.55 | 2.2 |
| 230107-315-GP | 07/01/23 | 345 | 29.1 | 150 | 3:45 | 2 | 30.8 | | | 105 | 21.7 | | | 1.8 | 0.53 | 2.2 |
| 221231-208-GP | 31/12/22 | 335 | 29.3 | 135 | 4:00 | 1 | 30.3 | 43.2 | | 90 | 22.3 | | | 1.7 | 0.52 | 2.2 |
| 221223-021-GP | 23/12/22 | 335 | 29.4 | 150 | 3:45 | 1 | 30.3 | 42.6 | | 100 | 21.3 | 33.3 | | 2.0 | 0.53 | 2.2 |
| 221220-706-GP | 20/12/22 | 320 | 29.5 | 135 | 4:00 | 1 | 30.9 | 44.4 | | | | | | 1.8 | 0.52 | 2.2 |
| 221217-703-GP | 17/12/22 | 325 | 29.5 | 135 | 4:00 | 1 | 32.9 | 44.6 | | 90 | 23.4 | 32.1 | | 1.8 | 0.54 | 2.2 |
| 221214-374-GP | 14/12/22 | 340 | 28.9 | 135 | 3:45 | 1 | 29.6 | 43.9 | 66.4 | | | | | 1.9 | 0.54 | 2.1 |
| 221212-372-GP | 12/12/22 | 335 | 28.8 | 120 | 3:30 | 1 | 31.1 | 43.2 | 65.2 | | | | | 2.2 | 0.56 | 2.1 |
| 221207-951-GP | 07/12/22 | 340 | 29.0 | 135 | 4:00 | 1 | 32.2 | 44.9 | 65.0 | | | | | 2.1 | 0.57 | 2.1 |
| 221205-949-GP | 05/12/22 | 340 | 29.2 | 135 | 3:45 | 1 | 32.3 | 44.5 | 65.3 | 100 | 22.5 | 30.5 | 45.4 | 2.2 | 0.57 | 2.1 |
| 221130-529-GP | 30/11/22 | 360 | 29.2 | 135 | 3:45 | 1 | 31.3 | 43.9 | 65.4 | 90 | 25.0 | 35.7 | 48.7 | 2.2 | 0.55 | 2.2 |
| 221128-527-GP | 28/11/22 | 355 | 29.1 | 135 | 4:00 | 2 | 31.5 | 44.1 | 64.6 | | | | | 2.3 | 0.55 | 2.2 |
| 221126-234-GP | 26/11/22 | 375 | 29.0 | 135 | 3:30 | 1 | 30.5 | 44.3 | 62.9 | 100 | 22.7 | 34.6 | 48.5 | 2.4 | 0.57 | 2.2 |
| 221124-236-GP | 24/11/22 | 355 | 29.1 | 135 | 3:30 | 1 | 31.1 | 43.3 | 62.1 | | | | | 2.4 | 0.55 | 2.1 |
| 221118-977-GP | 18/11/22 | 355 | 29.0 | 150 | 4:00 | 1 | 31.6 | 45.6 | 64.1 | | | | | 1.9 | 0.53 | 2.1 |
| 221113-975-GP | 13/11/22 | 350 | 28.9 | 150 | 3:45 | 1 | 33.6 | 48.8 | 65.7 | 90 | 24.4 | 34.2 | 52.6 | 1.4 | 0.54 | 2.2 |
| 221109-470-GP | 09/11/22 | 355 | 29.0 | 150 | 3:30 | 1 | 31.4 | 46.4 | 66.4 | 110 | 21.8 | 33.4 | 47.1 | 1.5 | 0.54 | 2.1 |
| 221107-504-GP | 07/11/22 | 370 | 29.0 | 150 | 3:45 | 1 | 31.2 | 46.7 | 64.8 | | | | | 2.0 | 0.53 | 2.2 |
| 221102-131-GP | 02/11/22 | 340 | 29.1 | 135 | 3:30 | 1 | 30.6 | 43.7 | 63.8 | | | | | 1.6 | 0.57 | 2.2 |
| 221031-129-GP | 31/10/22 | 350 | 29.1 | 135 | 3:30 | 1 | 31.3 | 42.8 | 65.3 | 100 | 22.5 | 33.3 | 46.3 | 2.0 | 0.53 | 2.3 |
| 221027-728-GP | 27/10/22 | 350 | 28.7 | 135 | 3:30 | 1 | 28.9 | 40.0 | 62.9 | 80 | 23.6 | 36.0 | 49.7 | 2.3 | 0.53 | 2.2 |
| 221025-726-GP | 25/10/22 | 335 | 28.8 | 135 | 3:15 | 1 | 29.6 | 43.5 | 65.6 | | | | | 2.1 | 0.55 | 2.2 |
| 221022-416-GP | 22/10/22 | 330 | 28.5 | 150 | 3:15 | 1 | 28.6 | 39.4 | 65.2 | 80 | 22.0 | 33.8 | 52.5 | 2.3 | 0.54 | 2.2 |
| 221016-418-GP | 16/10/22 | 335 | 28.5 | 135 | 3:15 | 1 | 29.2 | 41.6 | 68.5 | | | | | 2.2 | 0.53 | 2.2 |
| 221013-143-GP | 13/10/22 | 335 | 28.5 | 150 | 3:45 | 1 | 28.7 | 40.6 | 66.9 | | | | | 2.0 | 0.54 | 2.2 |

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of:

Chemical composition to ASTM C114-18

- Concrete Compressive Strength test results outside the scope of accreditation

Sample Retested

This Report must not be reproduced except in full

Raki Harding
Quality Manager



Portland Works, Portland, Whangarei 0178



Date issued: 20/01/2023

Page 1 of 3



EcoSure® Type GP Cement

Compressive Strength ISO-CEN Mortar (Bulk Dispatch)

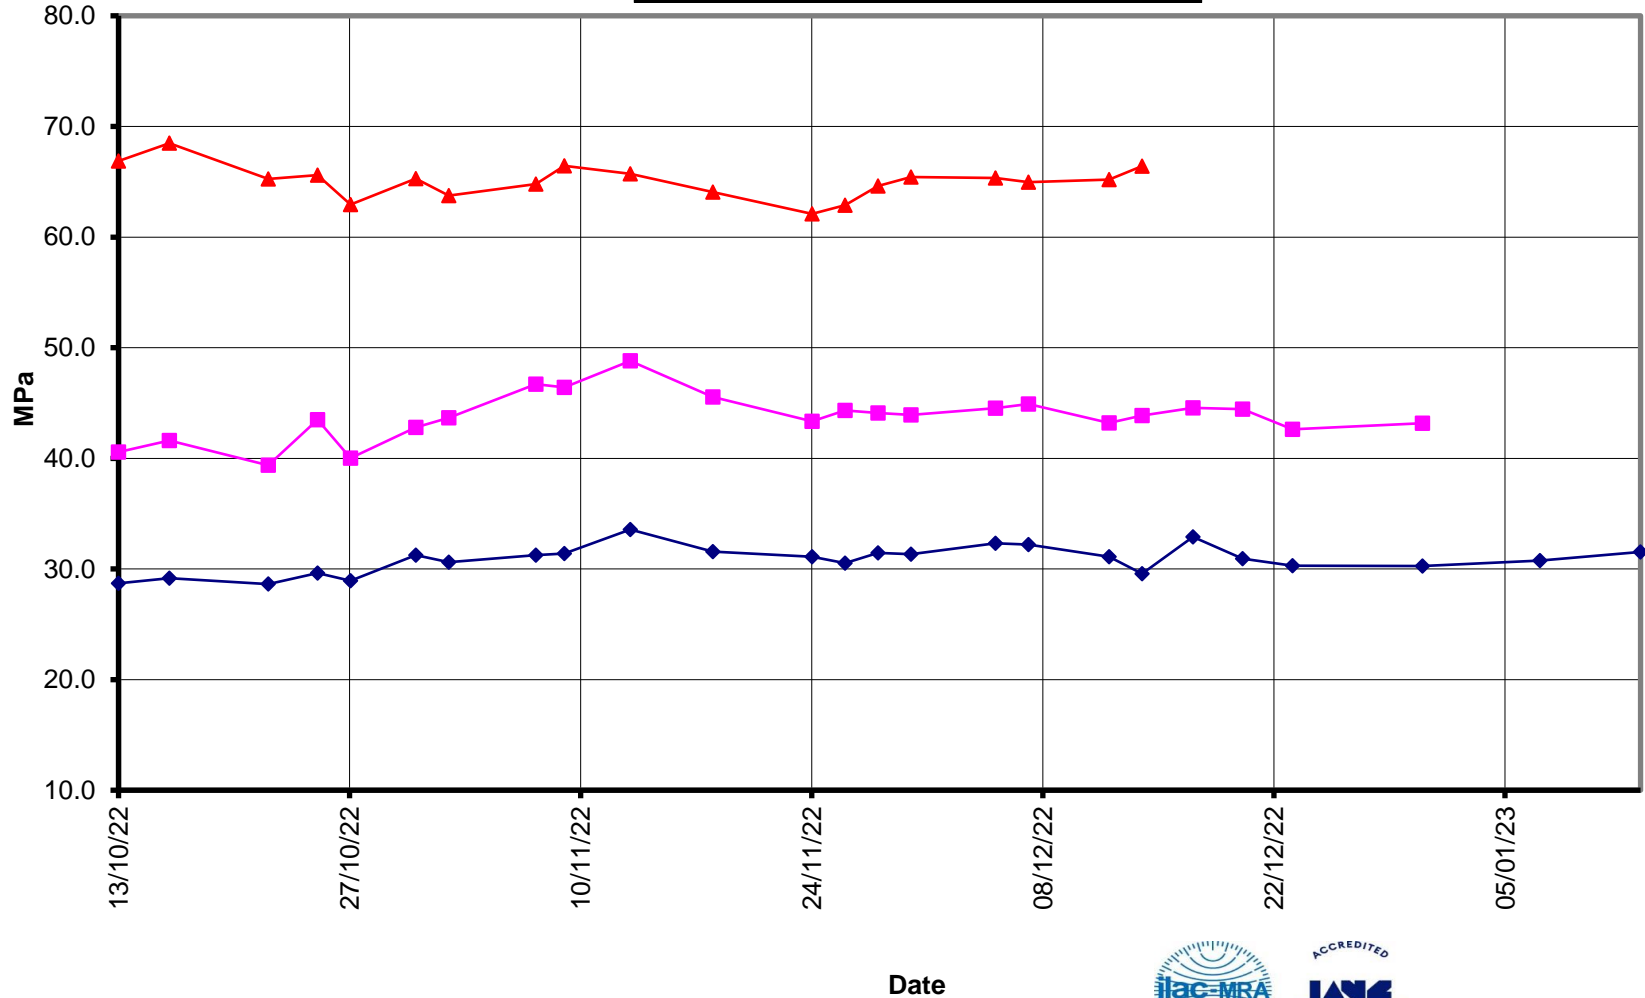



EcoSure® Type GP Cement

Compressive Strength Concrete (Bulk Dispatch)



—x— 28 Days —■— 7 Days —◆— 3 Days —x— Slump

