



CERTIFICATE OF QUALITY

EcoSure® Type GP Cement

NZS3122:2009 (Bulk & Bag Despatch)



Issued to: National Sales Manager

Test Report No: 23#123

info@goldenbay.co.nz

Code	Week Ending / Voyage	Specific Surface Area	Normal Consistency	Initial Set	Final Set	Soundness	Compressive Strength						Free Lime	Sodium Equivalent (NaEq)	Sulphur Trioxide (SO3)	
							ISOCCN			Concrete						
							3 days	7 days	28 days	Slump	3 days	7 days				28 days
Mean		350	29.7	139	3:36	1	34.6	47.2	65.6	90	26.1	37.4	49.3	1.6	0.54	2.35
Standard Deviation		10	0.3	11	0:10	0.4	1.1	1.7	0.7	8	2.2	3.0	3.3	0.2	0.01	0.02
Min		330	29.1	120	3:15	0	32.7	43.1	64.5	70	21.0	31.5	43.0	1.3	0.51	2.30
Max		365	30.3	150	4:00	2	36.8	50.2	67.0	100	29.0	41.5	55.0	2.0	0.56	2.40
NZS 3122:2009 Requirements				45 min	6:00 max	5 max		35.0 min	45.0 min						0.6 max	3.5 max
Units		m2/kg	%	minutes	hrs:mins	mm	MPa	MPa	MPa	mm	MPa	MPa	MPa	%	%	%
231028-990-GP	28/10/23	350	30.0	150	3:30	0	33.6			90	25.0			1.7	0.51	2.33
231024-978-GP	24/10/23	340	30.0	150	3:30	1	34.3							2.0	0.54	2.33
231019-725-GP	19/10/23	365	30.0	150	3:45	2	32.9	43.1						1.8	0.52	2.32
231016-722-GP	16/10/23	360	30.3	150	3:45	1	32.7	44.0		85	25.0	40.0		1.5	0.51	2.34
231011-414-GP	11/10/23	345	29.6	150	3:45	1	34.1	46.4		90	25.5	37.0		1.3	0.51	2.40
231006-050-GP	06/10/23	355	29.6	135	3:30	1	33.3	45.2		90	23.0	35.0		1.8	0.52	2.37
231002-045-GP	02/10/23	340	29.6	150	3:45	1	33.0	47.2						1.5	0.53	2.36
230927-762-GP	27/09/23	350	29.8	150	3:30	2	34.5	46.6	65.4					1.6	0.53	2.36
230924-755-GP	24/09/23	340	29.8	120	3:30	0	34.6	46.9	64.9	90	21.0	31.5	46.5	1.6	0.53	2.34
230919-450-GP	19/09/23	340	29.6	150	3:30	1	33.8	47.8	66.1	90	27.5	38.0	48.0	1.5	0.54	2.35
230915-073-GP	15/09/23	330	30.0	120	3:45	2	34.7	49.0	67.0					1.4	0.54	2.30
230910-071-GP	10/09/23	335	29.5	135	3:45	1	35.5	49.3	66.7	80	28.0	40.5	51.0	1.6	0.56	2.37
230907-634-GP	07/09/23	355	29.9	135	3:45	2	34.9	48.8	65.9					1.8	0.55	2.37
230902-629-GP	02/09/23	355	29.9	135	4:00	0	35.0	47.8	65.2	100	26.5	36.5	50.5	1.7	0.54	2.31
230829-392-GP	29/08/23	355	29.9	135	3:30	1	35.2	47.1	65.9	90	28.0	39.0	55.0	1.6	0.54	2.35
230824-052-GP	24/08/23	360	29.9	135	3:45	1	35.5	47.9	65.1	100	26.0	34.0	43.0	1.4	0.54	2.35
230822-050-GP	22/08/23	365	29.9	135	3:45	1	35.2	47.2	64.7					1.5	0.55	2.33
230818-641-GP	18/08/23	340	29.2	135	3:30	1	34.6	46.3	64.5	90	27.5	41.5	50.5	1.4	0.53	2.35
230814-639-GP	14/08/23	350	29.1	150	3:45	1	34.0	46.2	65.2					1.5	0.55	2.35
230809-298-GP	09/08/23	365	29.1	135	3:30	1	36.8	48.6	66.0	70	29.0	40.5	50.5	1.6	0.55	2.37
230807-296-GP	07/08/23	345	29.1	120	3:15	1	36.2	49.0	66.3					1.8	0.55	2.38
230803-092-GP	03/08/23	350	29.4	150	3:45	1	35.6	47.9	65.2					1.8	0.55	2.34
230731-086-GP	31/07/23	350	29.2	135	3:15	1	34.6	46.9	65.3	90	25.5	34.5	47.0	1.9	0.55	2.36
230728-782-GP	28/07/23	355	29.6	120	3:30	1	33.7	46.6	64.8					1.9	0.55	2.35
230723-746-GP	23/07/23	365	29.6	135	3:30	2	36.0	50.2	66.5	100	27.5	38.0	51.0	1.6	0.55	2.38

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of:
 Chemical composition to ASTM C114-18
 All concrete testing conducted in accordance with NZS 3112:1986.

This Report must not be reproduced except in full

Vincent Lane
Works Chemist



Portland Works, Portland, Whangarei 0178

Date issued: 3/11/2023

Page 1 of 3




EcoSure® Type GP Cement

Compressive Strength ISO-CEN Mortar (Bulk Dispatch)



28 Days 7 Days 3 Days

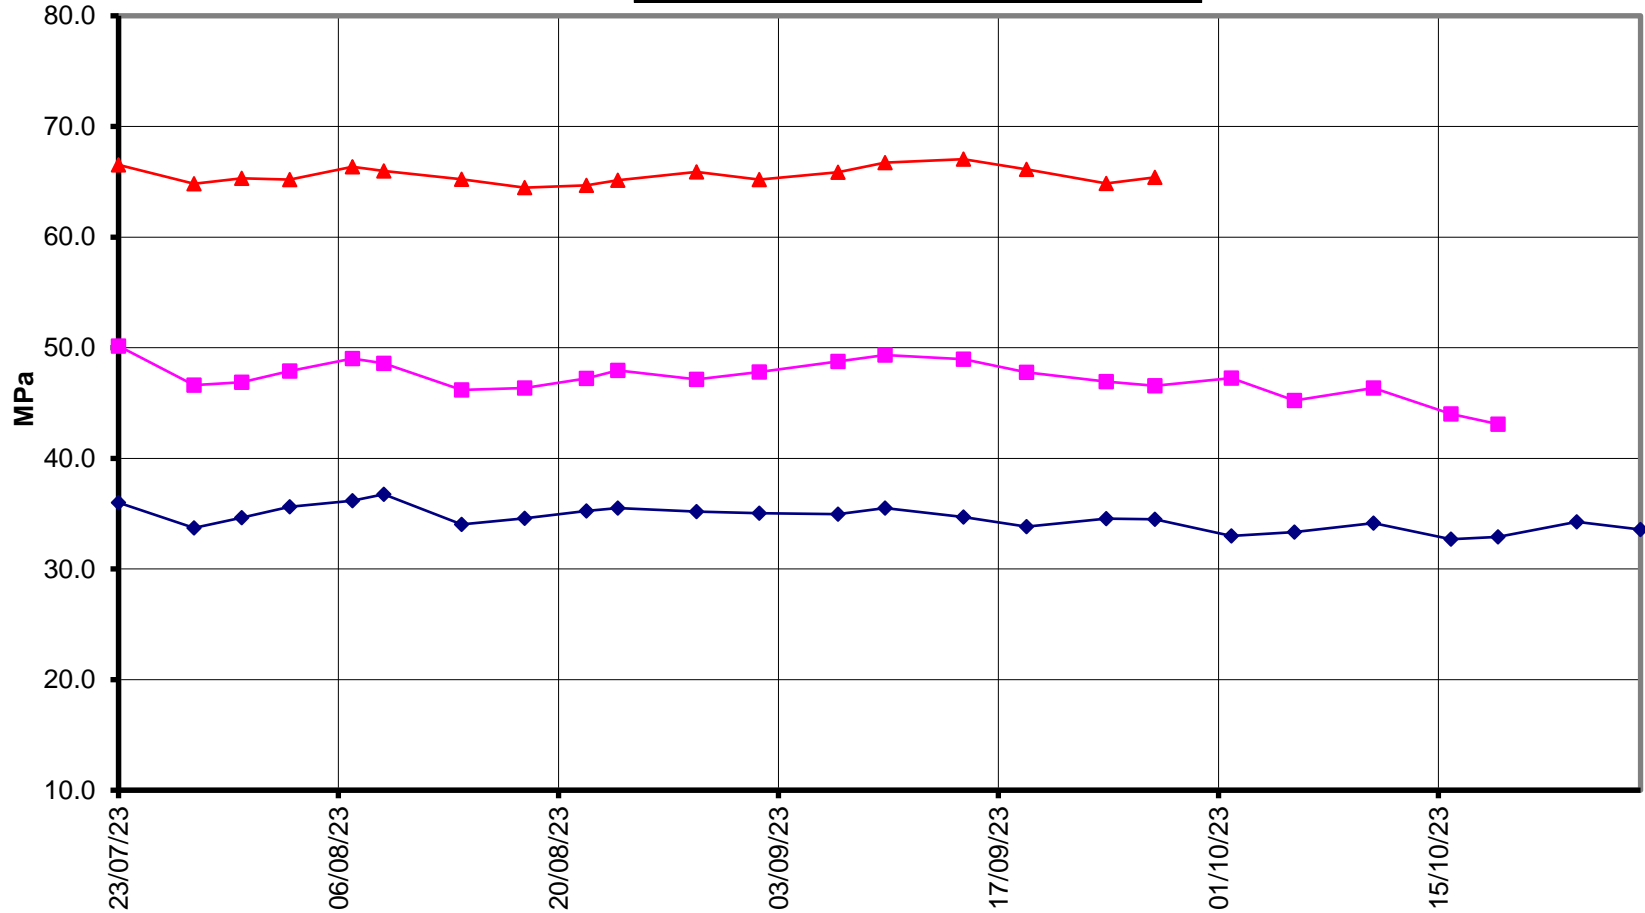



EcoSure® Type GP Cement

Compressive Strength Concrete (Bulk Dispatch)



—x— 28 Days —■— 7 Days —◆— 3 Days —x— Slump

