



CERTIFICATE OF QUALITY

EcoSure® Type GP Cement

NZS3122:2009 (Bulk & Bag Dispatch)



Issued to: National Sales Manager

Test Report No: 25#164

info@goldenbay.co.nz

Code	Week Ending / Voyage	Specific Surface Area	Normal Consistency	Initial Set	Final Set	Soundness	Compressive Strength								Free Lime	Sodium Equivalent (NaEq)	Sulphur Trioxide (SO ₃)
							ISOCEN			Concrete							
							3 days	7 days	28 days	Slump	3 days	7 days	28 days				
Mean		381	29.1	159	4:00	1	35.1	48.2	64.1	95	27.7	38.0	48.6	1.5	0.55	2.31	
Standard Deviation		11	0.2	8	0:10	0.5	0.9	0.9	1.5	10	2.1	2.2	2.9	0.1	0.02	0.04	
Min		360	28.3	150	3:45	0	33.8	46.6	61.7	80	24.0	35.0	44.0	1.3	0.51	2.22	
Max		400	29.5	165	4:30	2	37.1	49.8	66.6	110	31.0	43.0	53.0	1.8	0.58	2.38	
NZS 3122:2009 Requirements				45 min	6:00 max	5 max		35.0 min	45.0 min						0.6 max	3.5 max	
Units		m ² /kg	%	minutes	hrs:mins	mm	MPa	MPa	MPa	mm	MPa	MPa	MPa	%	%	%	
251016-271-GP	16/10/25	360	29.2	165	4:15	1	33.9							1.6	0.56	2.35	
251013-253-GP	13/10/25	370	29.2	165	4:15	1				100	24.0			1.5	0.56	2.31	
251004-986-GP	04/10/25	375	28.3	165	4:00	1	34.8	48.8		110	26.0	35.0		1.3	0.57	2.26	
251001-825-GP	01/10/25	385	29.1	150	3:45	1	34.3	48.2						1.5	0.58	2.32	
250928-815-GP	28/09/25	395	29.2	165	4:00	1	35.2	47.8		110	28.5	37.0		1.4	0.58	2.30	
250924-676-GP	24/09/25	375	29.1	165	4:00	1	34.7	48.3		80	26.0	37.0		1.3	0.58	2.27	
250920-413-GP	20/09/25	370	29.1	165	4:00	1	34.2	48.3	65.0	110	24.0	35.5	44.0	1.4	0.58	2.22	
250918-411-GP	18/09/25	385	29.1	150	4:00	2	33.8	47.9	63.3					1.8	0.56	2.36	
250913-136-GP	13/09/25	380	29.5	165	3:45	1	34.2	48.1	66.6					1.7	0.58	2.31	
250908-933-GP	08/09/25	390	29.2	150	4:00	0	34.7	48.4	65.2	90	31.0	39.5		1.4	0.58	2.30	
250902-653-GP	02/09/25	365	29.1	165	4:00	1	36.7	48.9	62.7	100	27.5	38.0	48.0	1.6	0.55	2.31	
250829-421-GP	29/08/25	385	29.1	150	4:00	1	36.0	48.9	64.2					1.4	0.56	2.32	
250825-419-GP	25/08/25	395	29.1	150	4:00	1	34.6	46.7		90	27.0	39.0	51.5	1.5	0.55	2.32	
250816-019-GP	16/08/25	385	29.1	165	4:00	2	35.4	47.4	61.7	90	28.0	38.5	53.0	1.5	0.55	2.38	
250812-711-GP	12/08/25	370	29.1	150	3:45	1	37.1	49.3	66.0	90	29.5	41.5	49.5	1.3	0.55	2.33	
250810-880-GP	10/08/25	370	29.1	150	3:45	1	36.4	49.6	63.0					1.6	0.56	2.32	
250807-535-GP	07/08/25	375	29.1	165	4:15	1	36.5	49.8	65.9					1.6	0.55	2.28	
250803-472-GP	03/08/25	375	29.1	150	4:30	1	34.7	47.8	64.3	90	27.0	37.0	47.0	1.4	0.55	2.28	
250731-291-GP	31/07/25	370	29.1	150	3:45	1	35.4	48.8	65.6	100	28.0	37.5	44.5	1.5	0.54	2.26	
250724-893-GP	24/07/25	400	29.1	150	4:00	0	34.7	47.6	63.6	90	30.0	37.0	49.0	1.5	0.53	2.33	
250719-722-GP	19/07/25	395	29.1	165	4:00	0	34.4	46.7	62.0	100	30.5	43.0	52.0	1.4	0.52	2.30	
250717-639-GP	17/07/25	390	29.1	165	4:00	0	34.9	49.0	65.9					1.5	0.54	2.26	
250710-325-GP	10/07/25	390	29.1	165	4:00	0	34.5	48.0	63.2					1.6	0.54	2.31	
250706-286-GP	06/07/25	390	29.1	165	4:00	0	35.4	46.6	62.5	90	27.0	35.0	48.0	1.6	0.52	2.34	
250702-068-GP	02/07/25	385	28.8	165	4:00	1	35.2	48.8	63.4	80	28.5	39.0	48.0	1.5	0.51	2.31	

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of:
Chemical composition to ASTM C114-23

All concrete testing conducted in accordance with NZS 3112:1986.

Re-test

This Report must not be reproduced except in full

Marley Korach-Salt

Marley Korach-Salt
Chemical Technician



Portland Works, Portland, Whangarei 0178


Date issued: 24/10/2025

Page 1 of 3



EcoSure® Type GP Cement

Compressive Strength ISO-CEN Mortar (Bulk Dispatch)

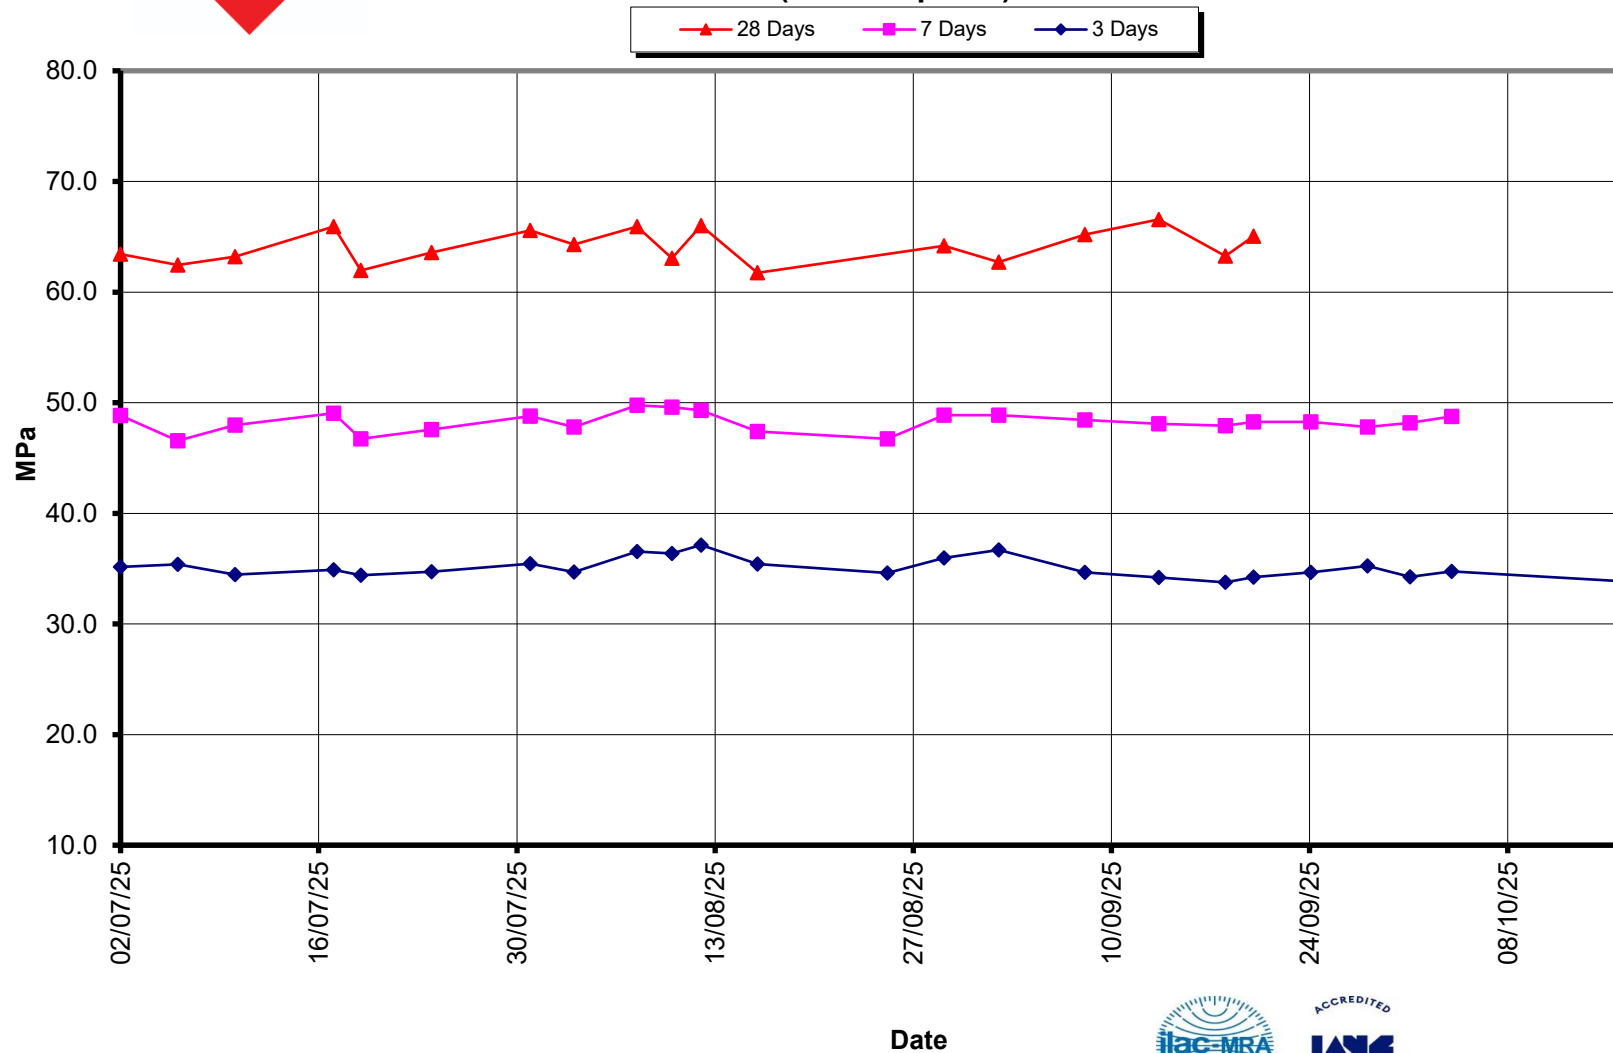



EcoSure® Type GP Cement

Compressive Strength Concrete (Bulk Dispatch)

EcoSure®
NZ's lowest carbon GP cement

—x— 28 Days —■— 7 Days —◆— 3 Days —x— Slump

