



CERTIFICATE OF QUALITY

EcoSure® Type GP Cement

NZS3122:2009 (Bulk & Bag Dispatch)



Issued to: National Sales Manager

Test Report No:

26#47

info@goldenbay.co.nz

Code	Week Ending / Voyage	Specific Surface Area	Normal Consistency	Initial Set	Final Set	Soundness	Compressive Strength						Free Lime	Sodium Equivalent (NaEq)	Sulphur Trioxide (SO ₃)	
							ISOCEN			Slump	Concrete					
							3 days	7 days	28 days		3 days	7 days				28 days
Mean		388	29.1	169	3:55	1	36.0	49.7	64.2	99	28.3	38.0	49.1	1.4	0.54	2.32
Standard Deviation		7	0.0	8	0:08	0.3	1.1	1.5	1.5	11	2.6	3.2	3.9	0.1	0.01	0.04
Min		375	29.1	150	3:45	1	33.5	45.9	61.6	80	24.0	33.5	43.0	1.2	0.52	2.24
Max		400	29.1	180	4:15	2	37.8	51.9	67.4	110	31.5	43.0	55.5	1.6	0.56	2.38
NZS 3122:2009 Requirements				45 min	6:00 max	5 max		35.0 min	45.0 min						0.6 max	3.5 max
Units		m ² /kg	%	minutes	hrs:mins	mm	MPa	MPa	MPa	mm	MPa	MPa	MPa	%	%	%
260327-858-GP	27/03/26	380	29.1	165	3:45	1	37.1	51.6						1.4	0.55	2.30
260322-721-GP	22/03/26	385	29.1	165	4:00	1	36.4	50.4		110	28.0			1.4	0.52	2.26
260318-396-GP	18/03/26	395	29.1	165	4:00	1	37.1	50.9						1.3	0.52	2.30
260314-394-GP	14/03/26	390	29.1	165	3:45	1	37.0	51.9		100	28.5	40.5		1.4	0.52	2.31
260309-033-GP	09/03/26	385	29.1	180	4:00	1	36.2	49.5						1.4	0.55	2.36
260306-031-GP	06/03/26	380	29.1	180	4:00	1	36.3	50.3		90	32.0	39.5		1.2	0.55	2.34
260302-689-GP	02/03/26	380	29.1	180	4:00	1	37.7	51.8	66.4	80	31.0	42.0	49.0	1.3	0.54	2.34
260228-687-GP	28/02/26	385	29.1	180	4:00	1	35.8	49.2	63.8					1.5	0.55	2.33
260226-351-GP	26/02/26	385	29.1	180	4:00	1	35.5	49.3	63.7	110	29.5	39.0	50.5	1.4	0.54	2.32
260221-349-GP	21/02/26	400	29.1	180	4:00	1	35.2	49.3	64.1					1.3	0.55	2.32
260218-877-GP	18/02/26	385	29.1	165	3:45	1	37.7	50.9	65.2					1.3	0.55	2.26
260216-875-GP	16/02/26	385	29.1	180	4:00	2	35.8	48.2	61.6	110	27.0	37.0	46.0	1.2	0.55	2.27
260211-612-GP	11/02/26	390	29.1	165	3:45	1	37.1	51.8	67.4					1.2	0.54	2.24
260209-611-GP	09/02/26	385	29.1	165	3:45	1	35.6	49.5	64.2	110	29.5	41.0	54.5	1.2	0.54	2.32
260206-219-GP	06/02/26	395	29.1	165	3:45	1	37.1	50.1	64.2					1.4	0.53	2.36
260203-217-GP	03/02/26	400	29.1	165	4:00	1	37.8	50.1	64.4	90	31.5	43.0	55.5	1.3	0.54	2.34
260130-056-GP	30/01/26	390	29.1	150	3:45	1	35.9	49.2	64.3	90	31.5	40.0	54.5	1.6	0.53	2.25
260126-017-GP	26/01/26	400	29.1	165	4:00	1	36.2	50.1	63.6					1.2	0.55	2.31
260122-852-GP	22/01/26	395	29.1	165	4:00	1	35.8	49.5	64.6	90	29.0	37.5	47.5	1.4	0.55	2.32
260113-675-GP	13/01/26	385	29.1	165	3:45	1	35.0	47.5	62.9					1.6	0.54	2.30
260109-670-GP	09/01/26	380	29.1	180	4:00	1	34.4	50.9	61.8	90	26.5	33.5	47.5	1.4	0.54	2.31
260104-291-GP	04/01/26	390	29.1	165	4:00	1	35.0	47.8	63.7	90	25.5	36.5	48.0	1.6	0.56	2.36
251231-871-GP	31/12/25	385	29.1	165	4:15	1	33.5	45.9	62.2	110	24.0	34.0	43.0	1.6	0.53	2.35
251224-615-GP	24/12/25	385	29.1	165	4:00	1	35.7	47.9	65.0	100	24.0	33.5	46.5	1.4	0.53	2.33
251218-347-GP	18/12/25	375	29.1	165	4:00	1	34.1	49.1	66.1	110	27.5	35.5	47.0	1.3	0.56	2.38

The above samples were tested as received in accordance with the current terms of accreditation and methods stated in NZS 3122:2009 with the exception of: Chemical composition to ASTM C114-23
All concrete testing conducted in accordance with NZS 3112:1986.

This Report must not be reproduced except in full

Marley Korach-Salt
Chemical Technician



Portland Works, Portland, Whangarei 0178

Date issued: 13/04/2026

Page 1 of 3




EcoSure® Type GP Cement

Compressive Strength ISO-CEN Mortar (Bulk Dispatch)



—▲— 28 Days —■— 7 Days —◆— 3 Days

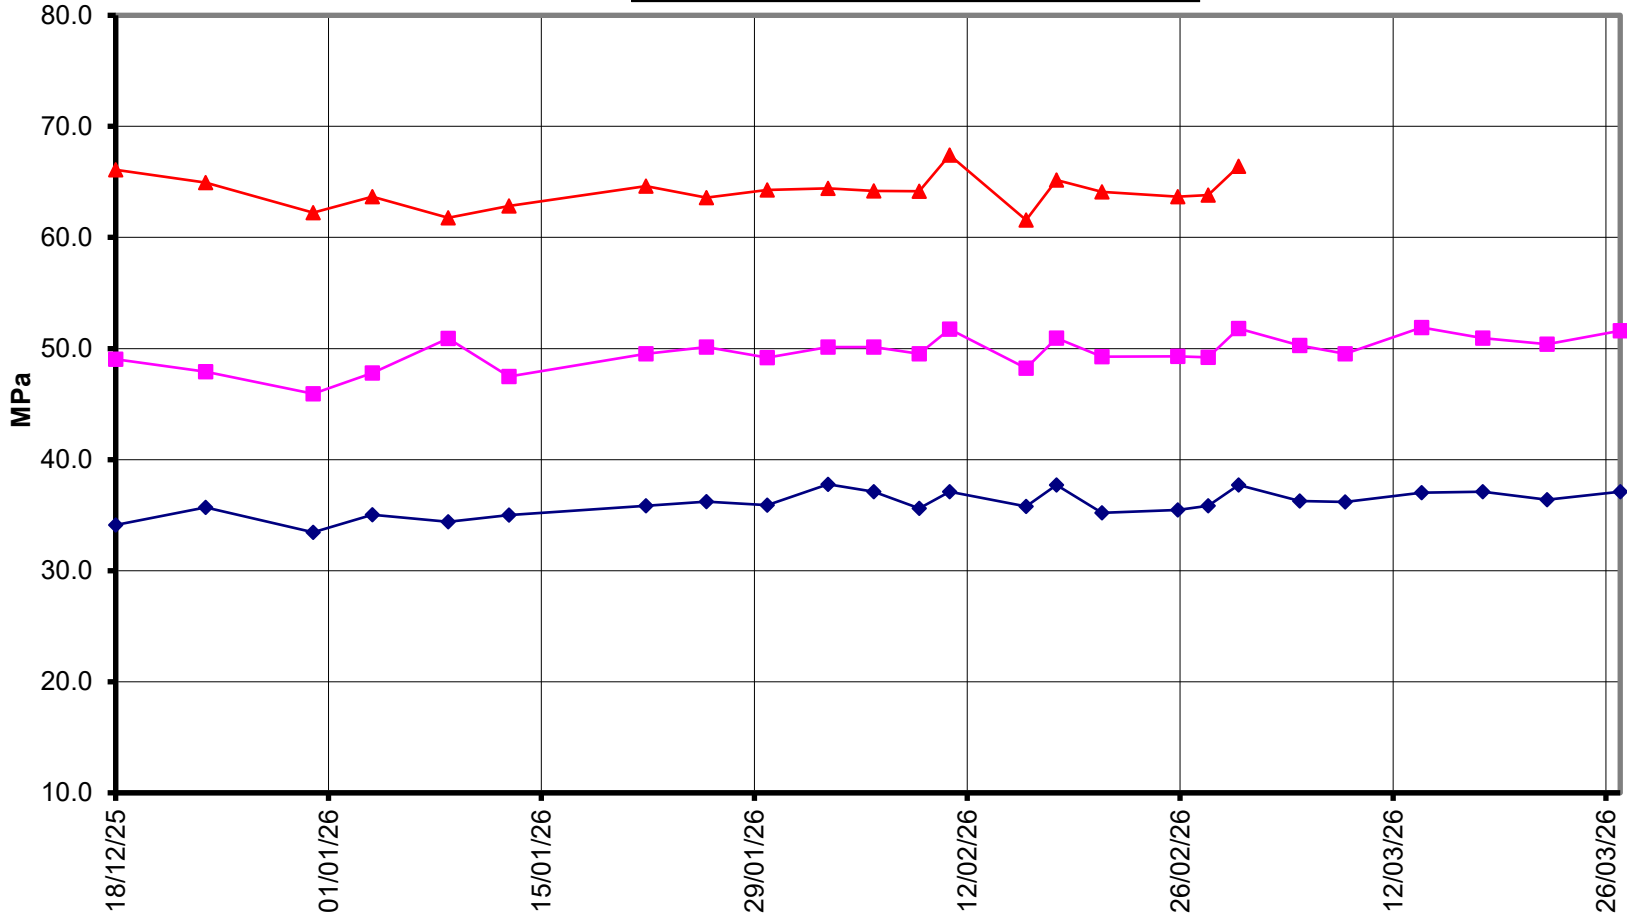



EcoSure® Type GP Cement

Compressive Strength Concrete (Bulk Dispatch)



—x— 28 Days —■— 7 Days —◆— 3 Days —x— Slump

